


SCALE 1"=1'

CARSON-BROOKS 1220-12 IRRIGATION BOX WITH BOLTED-DOWN COVER, OR APPROVED EQUIVALENT, WITH 1 7/8" HOLE THAT ALLOWS FOR THE INSTALLATION OF A TR PL PAD TOUCH READ DEVICE

METER SHALL BE PROVIDED BY THE CITY AND INSTALLED BY THE CONTRACTOR

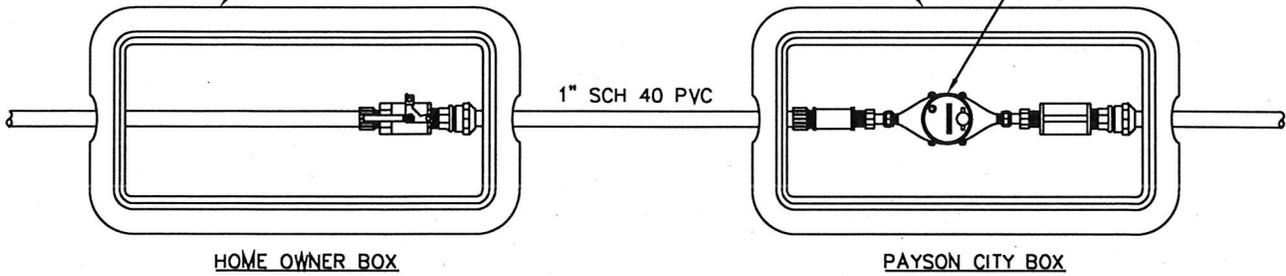


HOME OWNER BOX

PAYSON CITY BOX

APOLLO 1" 75-105-01 LOCKING BALL VALVE OR APPROVED EQUIVALENT

FORD 1" BC11-444SW STOP & WASTE VALVE OR APPROVED EQUIVALENT

GRADE

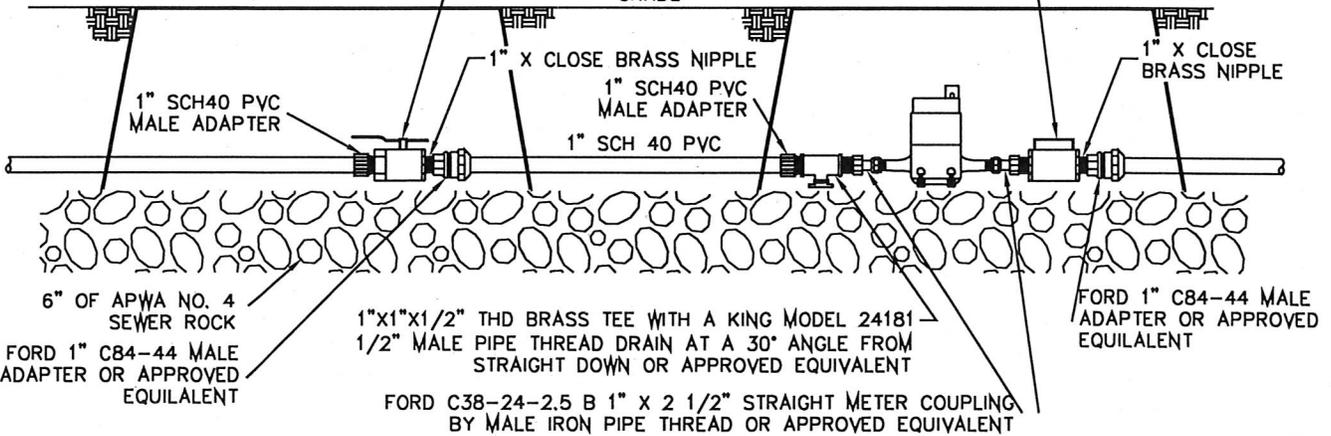

1" SCH40 PVC MALE ADAPTER

1" X CLOSE BRASS NIPPLE  
1" SCH40 PVC MALE ADAPTER  
1" SCH 40 PVC

1" X CLOSE BRASS NIPPLE


6" OF APWA NO. 4 SEWER ROCK  
FORD 1" C84-44 MALE ADAPTER OR APPROVED EQUIVALENT

1"x1"x1/2" THD BRASS TEE WITH A KING MODEL 24181 1/2" MALE PIPE THREAD DRAIN AT A 30° ANGLE FROM STRAIGHT DOWN OR APPROVED EQUIVALENT

FORD 1" C84-44 MALE ADAPTER OR APPROVED EQUIVALENT

FORD C38-24-2.5 B 1" X 2 1/2" STRAIGHT METER COUPLING BY MALE IRON PIPE THREAD OR APPROVED EQUIVALENT

SCALE 1"=3'

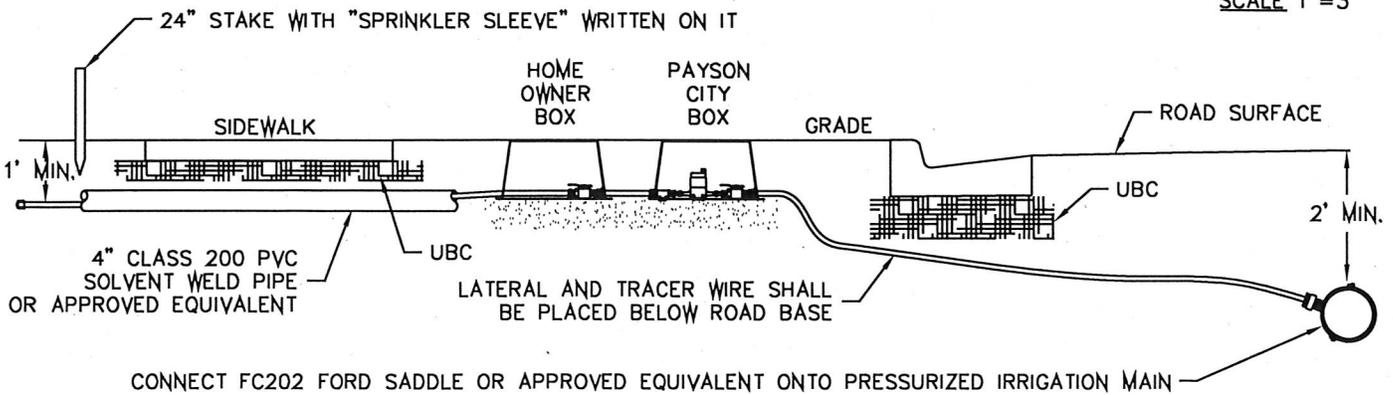

CONNECT FC202 FORD SADDLE OR APPROVED EQUIVALENT ONTO PRESSURIZED IRRIGATION MAIN

NOTES:

1. STANDARD SERVICE SIZE SHALL BE 1 1/2" FOR DUAL SERVICES AND 1" FOR SINGLE SERVICES.
2. STAINLESS STEEL LINER INSERTS WILL BE REQUIRED INSIDE OF TUBING AT COMPRESSION FITTINGS.
3. ALL FITTINGS SHALL BE COMPATIBLE WITH SERVICE SIZE.
4. SERVICE LATERAL SHALL SLOPE TOWARDS PRESSURIZED IRRIGATION MAIN.
5. SPRINKLER SLEEVE SHALL NOT BE IN LINE WITH ANY UTILITY BOXES.
6. 1/2" POLY CONDUIT SHALL BE BURIED 2' BELOW GRADE.
7. NO OTHER CONNECTIONS OR EQUIPMENT ARE PERMITTED BY CONTRACTOR/HOME OWNER INSIDE PAYSON CITY BOX.



PAYSON CITY  
439 WEST UTAH AVE.  
PAYSON, UT 84651  
(801) 465-5200

STANDARD DRAWING

1" PRESSURIZED IRRIGATION SERVICE BOX & LATERAL

SCALE VARIES

STANDARD  
1 OF 1